$oldsymbol{i}^3$ CX Intelligent Control Station

IMO

- 640 x 480 colour touch display
- High resolution resistive touch screen
- Addressable function keys
- Real time clock
- Built-in Ethernet
- 3 x communications ports (RS 232 / RS 485)
- 1 x USB A, 1 x USB mini B
- 10 30 VDC power supply
- 1MB RAM (program), 27MB (Graphical)
- Free configuration software
- IP65 (NEMA4)
- Remote I/O communication
- Optional: MicroSD (up to 32GB)
 Modem (SMS, GSM, GPRS)
 USB drive up to 2TB






Options & Ordering Codes

Standard Options	DI	D0	Al	AO
i3CX12Z/10D03-SEHF	12	6 Relay	4	-
i3CX12Z/13C14-SEHF	12	12	2*	2
i3CX12C/20B05-SEHF	24	16	4	-
i3CX12Z/10B04-SEHF	12	12	2	-
i3CX12Z/10E24-SEHF	12	12	6*	4
i3CX12Z/00000-SEHF	-	-	-	-

^{*} Universal Analog Inputs

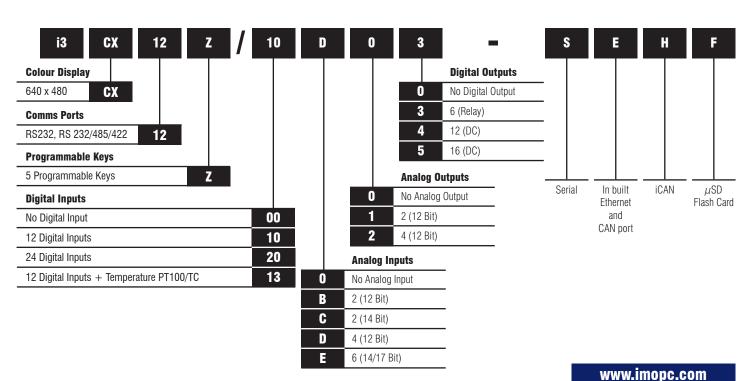

$oldsymbol{\dot{i}}^3$ CX Intelligent Control Station



Technical Specifications

General Specifications	
Required Power (Steady State)	420mA @ 12VDC / 230mA @ 24VDC
Required Power (Inrush)	25A for <1ms @ 24VDC DC Switched
Primary Power Range	10-30VDC
Relative Humidity	5 to 95% Non-Condensing
Clock Accuracy	+/-20ppm Maximum at 25°C (+/-1 Minute per month)
Operating Air Temperature	-10°C to +60°C
Storage Temperature	-40°C to +60°C
Weight	1.98kg / 4.375 lbs (without I/O)
Approvals	UL, CE


Control & Logic Specifications				
Control Language Support	Advanced Ladder Logic Full IEC 61131-3			
Logic Program Size & Logic Scan Rate	1MB Maximum 0.013ms/k			
Online Programming Changes	Supported in Advanced Ladder			
	Digital Inputs - 2048			
I/O Cupport	Digital Outputs - 2048			
I/O Support	Analog Inputs - 512			
	Analog Outputs - 512			
General Purpose Registers	50,000 (words) Retentive 16,384 (bits) Retentive 16,384 (bits) Non-retentive			

Display Specifications	
Display Type	5.7" VGA TFT (450 nit typical)
Resolution	640 x 480
Colour	16-bit (65,536)
Screen Memory	27MB
User-Programmable Screens	1023
Backlight	LED - 30,000 hour life
Screen Update Rate	User configurable within the scan time. (perceived as instantaneous in many cases)


Connectivity	
Serial Ports	1 RS-232 & 1 RS-485 on first modular jack (MJ1/2) 1 RS-232 or 1 RS-485 on second Modular Jack (MJ3)
USB mini-B	USB 2.0 (480MHz) Programming & Data Access
USB A	USB 2.0 (480MHz) for USB FLASH Drives (up to 2TB)
CAN	Remote I/O, Peer-to-Peer Comms, i3 Configurator
Ethernet	10/100MB (Auto-MDX), Modbus TCP, HTTP, FTP, SMTP, i3 Configurator, Ethernet IP
Remote I/O	IOS, Smart IO, iSmart
Removable Memory	MicroSD (support for 32GB max) Application updates, Datalogging, more

2
1
500kHz each
32-bits each
Supported
Quadrature
Frequency Measurement
r

Dimensions & Panel Cutout

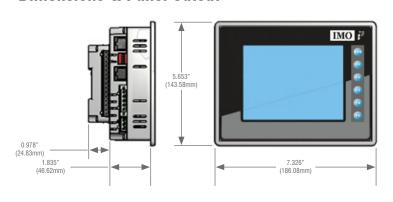


*Up to six mA/V In, RTD/TC, and mA/V Out

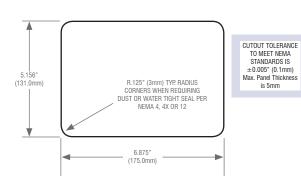

$oldsymbol{i}^3$ CX Intelligent Control Station

IMO

Ports & Connectors



DC Input / Frame

Torque rating: 4.5-7 Lb-in (0.50-0.78Nm)

DC- is internally connected to I/O V-, but is isolated from CAN V-

A Class 2 power supply must be used


Primary Power Port Pins			
Pin	Signal	Signal Description	
1	Ground	Frame Ground	
2	DC-	Input Power Supply Ground	
3	DC+	Input Power Supply Voltage	




MJ1/2 Independent Serial Ports

MJ1: RS-232 w/Full Handshaking MJ2: RS-485 Half-Duplex

PIN	MJ1 PINS		MJ2 I	PINS
	Signal	Direction	Signal	Direction
8	TXD	OUT	-	-
7	RXD	IN	-	-
6	0 V	Ground	0 V	Ground
5	+5V@60mA	OUT	+5V@60mA	OUT
4	RTS	OUT	-	-
3	CTS	IN	-	-
2	-	-	RX- / TX-	IN / OUT
1	-	-	RX+/TX+	IN / OUT



DIP Switches



Switch	Name	Function	Default
1	MJ3 RS485 Termination	ON = Terminated	OFF
2	M I2 Duploy	ON = Half	OFF
3	MJ3 Duplex	OFF = Full	UFF
4	MJ3 RS485 Termination	ON = Terminated	OFF

Fixed	Digital/Analog			i3CX Model		
Address I/O Function	I/O Function	10D03	10B04	20B05	13C14	10E14
	Digital Inputs	1-12	1-12	1-24	1-12	1-12
%I1	Reserved	13-32	13-31	25-31	13-31	13-31
	ESCP Alarm	n/a	32	32	32	32
%Q1	Digital Outputs	1-6	1-12	1-16	1-12	1-12
76 U I	Reserved	7-24	13-24	17-24	13-24	13-24
%AI1	Analog Inputs	1-4	1-2	1-2	1-2	1-4:33-38
70AII	Reserved	5-12	3-12	3-12	3-12	n/a
%AQ1	Reserved	n/a	1-8	1-8	1-8	1-12
/0AUT	Analog Outputs	n/a	n/a	n/a	9-10	n/a

Reserved areas maintain backward compatability with other i3 Controller models



CAN

Locking Spring-Clamp 2-Terminators Per Conductor Mounting screw torque rating: 4.5 Lb-in (0.50Nm)

SHLD and V+ pins are not internally connected to i3CX

Primary Power Port Pins				
Pin	Signal Description Directio		Direction	
1	V-	CAN Ground - Black	-	
2	CN L	CAN Data Low - Blue	IN / OUT	
3	SHLD	Shield Ground - None	-	
4	CN H	CAN Data High - White	IN / OUT	
5	V+ (NC)	No Connect - Red	-	



MJ3 Serial Port

2 multiplexed Serial Ports on One Modular Jack (8posn)

PIN	MJ3 PINS	
	Signal	Direction
8	TXD RS232	OUT
7	RXD RS232	IN
6	0 V	Ground
5	+5V@60mA	OUT
4	TX- RS485	OUT
3	TX+ RS485	OUT
2	RX- RS485	IN
1	RX+ RS485	IN

Built-in I/O

I/O is mapped into i3 Register space, in three separate areas — Digital/Analog I/O, High-Speed Counter I/O, and High-Speed Output I/O. Digital/Analog I/O location is fixed starting at 1, but the High-Speed Counter and High-Speed Output references may be mapped to any open register location. For more details on using the High-Speed Counter and High-Speed Outputs, see the i3CX User's Manual.

Default Address*	High Speed Counter Function	i3CX Models
%I1601	Status Bits	1-8
&Q1601	Command Bits	1-32
%AI0401	Accumulator 1&2	1-8
%AQ0401	Preload & Match Values	1-12

*Starting Address locations for %I, %Q, %AI & %AQ may be re-mapped by user

Default Address*	High Speed Output Function	i3CX Models
%I1617	Status Bits	1-8
&Q**	Command Bits	1-32
n/a	n/a	n/a
%AQ0421	PWM or Pulse Train Parameters	1-20

*Starting Address locations for %I & %AQ may be re-mapped by user

**Q1-Q2 are part of the Fixed I/O Map. In High Speed Output mode they can be used to initiate a Stepper/PTO Move

*i*³CX Intelligent Control Station



10E24 I/O Board Specifications

D	Digital DC Inputs	Digital C	OC Outputs
Inputs per Module	12	Outputs per Module	12
Commons per Module	1	Commons per Module	1
Input Voltage Range	10-30 VDC	Output Type	Sourcing / 10 K Pull-Down
Absolute Max Voltage	35 VDC Max	Absolute Max Voltage	30 VD Max
Input Impedance	10 kΩ	Output Protection	Short Circuit & Overvoltage
Input Current	Positive Logic Negative Logic	Max Output Current per Point	0.5A
Upper Threshold	0.8mA -1.6mA	Max Total Current per driver	2 A Continuous
Lower Threshold	0.3mA -2.1mA	Max Output Supply Voltage	30 VDC
Min "On" Input	8 VDC	Min Output Supply Voltage	10 VDC
Max "Off" Input	3 VDC	Max Voltage Drop at Related Current	0.25 VDC
Galvanic Isolation	None	I/O Indication	None
OFF to ON Response	1 ms	Galvanic Isolation	None
ON to OFF Response	1 ms	Min Load	None
Logic Polarity	Positive and Negative based on Common pin level.	OFF to ON Response	150 ns
I/O Indication	None	ON to OFF Response	150 ns
High Speed Counter Inputs	4 - DIN 8-12	PWM Out	500KHz
High Speed Counter Max Fre		Output Characteristics	Current Sourcing (Postitive Logic)
Connector Type	3.5mm Pluggable cage clamp connector		<u> </u>
	Analog Inputs	s, High Resolution	
Number of Channels	6	Absolute Max Input Voltage	-0.5 to 12V DC
Input Range	0-20mA, 4-20 mA dc. 0-60mV, 0-10V dc. TC - J, K, N, T, E, R, S, B RTD - PT100, PT1000	Input Impedance (Clamped @ -0.5 to 10.23VDC).	TC / RTD / mV >2 M Ω mA: 15 Ω + 1.5 V V: 1.1 M Ω
Nominal Resolution	14 - 17 Bits (variable depending on input type)	Galvanic Isolation	None
Sensor Range and Accurac	y Input Type	Range	Accuracy
	TC J	-120 to 1000°C / -184 to 1832°F	± 0.2% FS ± 1°C
	TC K	-130 to 1372°C / -202 to 2501.6°F	± 0.2% FS ± 1°C
·	TC T	-130 to 400°C / -202 to 752°F	± 0.2% FS ± 1°C
	TC E	-130 to 780°C / -202 to 1436°F	± 0.2% FS ± 1°C
,	TC N	-130 to 1300°C / -202 to 2372°F	± 0.2% FS ± 1°C
	TC R, S	20 to 1768°C / 68 to 3214.4°F	± 0.2% FS ± 3°C
	TC B	100 to 1820°C / 212 to 3308°F	± 0.2% FS ± 3°C
	PT100/1000	-200 to 850°C / -328 to 1562°F	± 0.15% FS
	0-20mA	0-20mA	± 0.15% FS
	0-60mV	0-60mV	± 0.15% FS
	0-10V	0-10V	± 0.15% FS
Conversion Speed		nverted in approx. 150mS	
	Analo	g Outputs	
Number of Channels	4	Minimum Current Load	500Ω
Output Ranges	0-10VDC, 0-20mA, 4-20mA	Galvanic Isolation	None
Nomimnal Resolution	12 Bits	Conversion Speed	Min all channels once per scan
Response Time	One update per ladder scan		
Max Error at 25°C (excluding zero)	0-20mA 0.1% of FS 0-10V 0.1% of FS	Additional Error for temperatures other than 25°C	20mA 0.0126%/°C

$oldsymbol{\dot{i}}^{\scriptscriptstyle 3}$ CX Intelligent Control Station










For ease of operability, the high density terminals are divided into more manageable pairs of connectors (J1A + J1B, J2A + J2B, J3A + J3B)

To ensure proper installation, connector symbols must match as seen below:




ľ	I	J	U	ľ	I	I	ı	ı	I	ı	I	ı	I	I	I	I	I
0	0	0	0	u	0	u	a	0	0	a	0	a	u	0	0	0	0
9	5	8	8	9	3	9	9	L	L	9	9	9	5	9	8	8	Ŀ
۹	ja,	-		в	В	а	C	٦	ř			٠	٠	٠	٠	٠	٠


ange/Green)	Signal Name		- 11
11	V IN1		12
12	V IN2		13
13	V IN3		14
14	V IN4	§+	15
l5	V IN5	\$ -\ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \	16
16	V IN6		17
17	V IN7		
18	V IN8		18
H1	HSC1 / V INQ		H1
			H2
			H3
			H4
			0V
		20mA	A1A
		Transmitter T	A1B
			A1C
		_	N/C
		T/C (-	A2A
		•	A2B
		_	A2C
		_	N/C
	12 13 14 15 16	11	11

J2 (BI	ack/Green)	Signal Name	V3
	V3	V OUT 3*	V2 0-10V Out
	V2	V OUT 2*	V1
	V1	V 0UT 1*	mA4 Loso
	mA4	mA Out 4*	mA3
2A	mA3	mA Out 3*	mA2
	mA2	mA Out 2*	mA1
	mA1	mA Out 1*	Q1 LOID
	Q1	OUT 1 / PWM1	Q2 [TOTAL
	Q2	OUT 2 / PWM2	Q3 [1010]
	Q3	OUT 3	Q4 E000
	Q4	OUT 4	
	Q5	OUT 5	Q5
	Q6	OUT 6	Q6
	Q7	0UT 7	Q7 Loib
ЛВ	Q8	OUT 8	Q8
5	Q9	OUT 9	Q9 LOLD
	Q10	OUT 10	Q10 E005
	Q11	OUT 11	Q11
	Q12	OUT 12	Q12 L0310
	V+	V External+	V+

Common

J3 (Or	ange/Green)	Signal Name		
ightharpoons	NC	No Connect		
•	A3A	Univ. Al 3 pin 1		
	A3B	Univ. Al 3 pin 2		
₹	A3C	Univ. Al 3 pin 3		
Univ. Al	NC	No Connect		
'n	A4A	Univ. Al 4 pin 1		
	A4B	Univ. Al 4 pin 2		
	A4C	Univ. Al 4 pin 3		
	NC	No Connect		
	A5A	Univ. Al 5 pin 1		
	A5B	Univ. Al 5 pin 2		
	A5C	Univ. Al 5 pin 3		
₹	NC	No Connect		
Univ. Al	A6A	Univ. Al 6 pin 1		
	A6B	Univ. Al 6 pin 2		
	A6C	Univ. Al 6 pin 3		
	NC	No Connect		
	V4	V OUT4*		






Note * Both mA & V outputs are active for each output channel, however, only the configured output type is calibrated (maximum 4 channels simultaneously).

i^3 CX Intelligent Control Station



Example of Universal Input Wiring Schematic

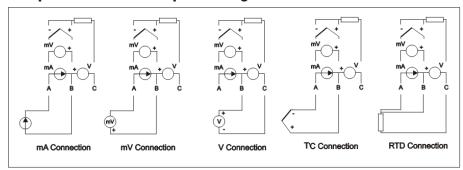

Configuration

The data registers as follows:-

Digital Inputs	Digital Outputs	Analog Inputs	Analog Outputs
%I1-12	%Q1-12	%AI1-4, %AI33-38	%AQ9-12

Note: The first four analog inputs are mapped to both %Al1-4 and %Al33-36, analogue input channels 5 & 6 are mapped to %Al37 and %Al38 respectively only.

Data Values

The analogue inputs return data types as follows:-

Input Mode	Data Format	Comment
0-20mA, 4-20mA	0-32000	
0-10V, 0-60mV	0-32000	
TC, RTD	Temperature in °C or °F to 1 decimal place xxx.y	°C or °F may be selected in the I/O config section. The value is an integer, the user should divide by 10.

Status Register

Register	Descriptions							
%R1	Bit-wise status re	gister enable – R1.1	- R1.9 enable for reg	isters R2 to R9				
%R2	Firmware version							
%R3	Watchdog count -	– cleared on power-u	p.					
%R4	Status bits -				164	3	2	1
%K4					Reserved	Normal	Config	Calibration
%R5	Scan rate of the 1	0E24 board (average	e) in units of 100μ S.	'	'			
%R6	Scan rate of the 1	0E24 board (max) ir	units of 100µS.					
%R7	Channel Status	Channel 2			Channel 1			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R8	Channel Status	Channel 4			Channel 3			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R9	Channel Status	Channel 6			Channel 5			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R10-14	Reserved							

Note: For the purposes of the example, the block is shown starting at %R1, but it can be set to anywhere in the %R memory map.

$oldsymbol{i}^3$ CX Intelligent Control Station



Safety

WARNING: Battery may explode if mistreated. Do not recharge, disassemble or dispose of in fire.

WARNING: EXPLOSION HAZARD - BATTERIES MUST ONLY BE CHANGED IN AN AREA KNOWN TO BE NON-HAZARDOUS

This equipment is suitable for use in Class 1, Division 2, Groups A, B, C and D or Non-hazardous locations only.

FOR U.S. & CANADA ONLY

Power input and output (I/O) wiring must be in accordance with Class 1, Division 2 wiring methods of the National Electric Code, NFPA70 for installations in the U.S. or as specified in Section 18-1J2 of the Canadian Electric Code for installations within Canada and in accordance with the authority having jurisdiction.

WARNING: EXPLOSION HAZARD - Do not disconect equipment unless power has been switched off or the area is known to be non-hazardous.

WARNING: EXPLOSION HAZARD - Substitution of components may impair suitability for Class 1, Division 2.

Digital outputs shall be supplied from the same source as the i3 Controller.

WARNING: Only qualified electrical personnel familiar with the construction and operation of this equipment and the hazards involved should install, adjust, operate, or service this equipment. Read and understand this manual and other applicable manuals in their entirety before proceeding. Failure to observe this precaution could result in severe bodily injury or loss of life.

WARNING: To avoid the risk of electric shock or burns, always connects the earth ground before making any other connections.

WARNING: To reduce the risk of fire, electrical shock, or physical injury it is strongly recommended to fuse all Power Sources connected to the i3 controller. Be sure to locate fuses as close to the source as possible.

WARNING: Replace fuse with the same type and rating to provide protection against risk of fire and shock hazards.

WARNING: In the event of repeated failure, do not replace the fuse again as a repeated failure indicates a defective condition that will not clear by replacing the fuse.

Jumpers on connector JP1 and others shall not be removed or replaced while the circuit is live unless the area is known to be free of ignitable concentrations of flammable gases or vapours.

Common Cause of Analog Input Tranzorb Failure

If a 4-20mA circuit is initially wired with loop power, but without a load, the Analog Input could see 24VDC. This is higher than the rating of the tranzorb. This can be solved by NOT connecting loop power prior to load connection, or by installing a low-cost PTC in series between the load and Analog Input.

