

# i<sup>3</sup> AX Intelligent Control Station


- 128 x 64 Monochrome LCD Display
- MicroSD™ Data storage
- Real Time Clock
- 1 CAN Port, 2 RS-232 / RS-485
- **1 Integral Ethernet Port**
- Addressable function keys
- 256kB RAM (Program), 16MB (Graphical)
- IP65 (NEMA4X)
- 10 - 30 VDC Power Supply
- Free Configuration Software
- Remote I/O Communication
- Optional - Modem (SMS, GSM, GPRS)
- **Supports i<sup>3</sup>RMI Webserver Functionality**



## Options & Ordering Codes

Standard Options	DI	DO	AI	AO
i3AX12X/10D03-SEHF	12	6 Relay	4	-
i3AX12X/13C14-SEHF	12	12	2*	2
i3AX12X/20B05-SEHF	24	16	2	-
i3AX12X/10B04-SEHF	12	12	2	-
i3AX12X/10E24-SEHF	12	12	6*	4

\* Universal Analogue Inputs

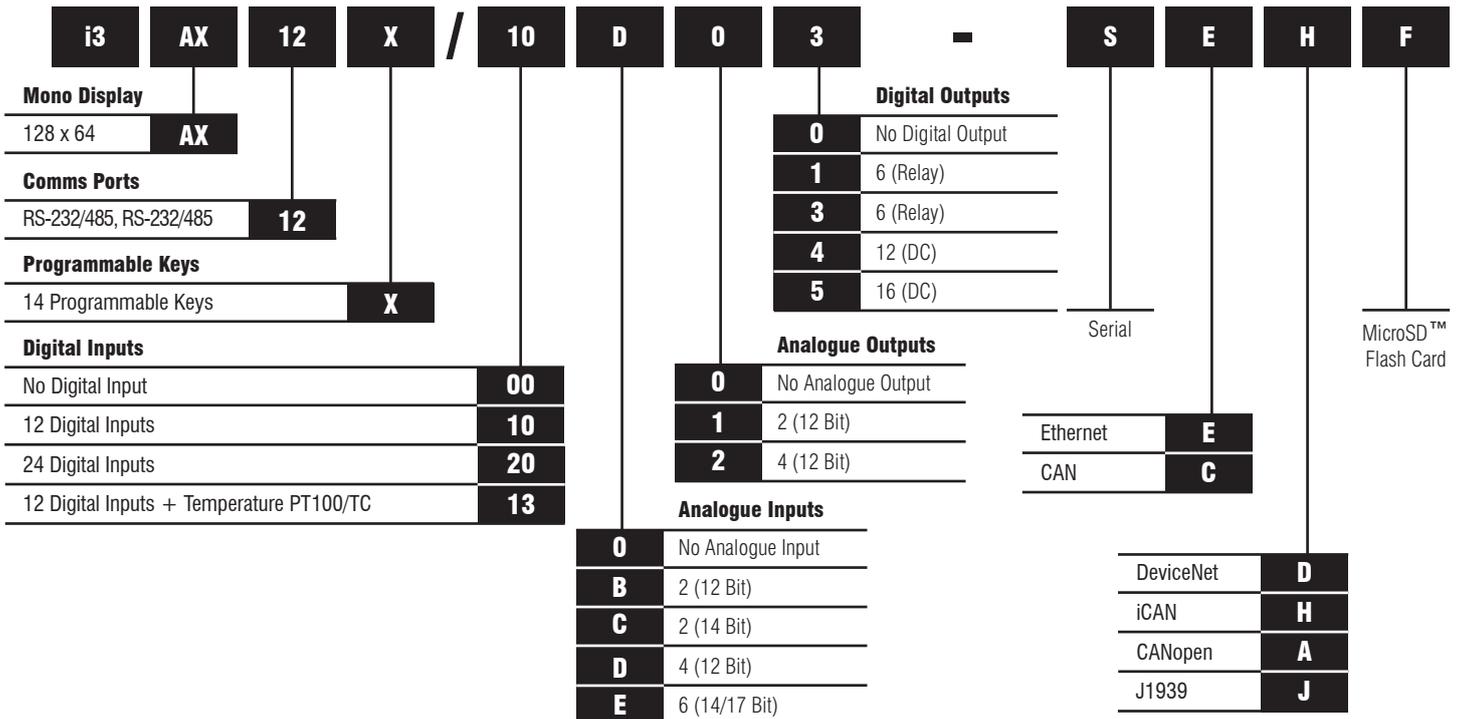

# i<sup>3</sup> AX Intelligent Control Station

## Technical Specifications

General Specifications	
Required Power (Steady State)	84mA @ 24VDC
Required Power (Inrush)	30A for 1ms @ 24VDC
Primary Voltage Range	10-30VDC
Relative Humidity	5 to 95% Non-Condensing
Clock Accuracy	+/-90 seconds per month at 20°C
Operating Temperature	-10°C to +60°C
Storage Temperature	-20°C to +70°C
Weight	0.340kg
Approvals	cUL, UL, CE, FCC



Control & Logic Specifications	
Control Language Support	Advanced Ladder Logic Full IEC 61131-3
Logic Program Size & Logic Scan Rate	256kB Maximum 0.7ms/k
I/O Support	Digital Inputs - 2048
	Digital Outputs - 2048
	Analogue Inputs - 512
	Analogue Outputs - 512
General Purpose Registers	9,999 (words) Retentive 2,048 (bits) Retentive 2,048 (bits) Non-retentive

Display Specifications	
Display Type	Trans-reflective LCD (outdoor readable)
Resolution	128 x 64
Colour	Monochrome
Screen Memory	16MB
User-Programmable Screens	1023 (max. 50 objects per screen)
Backlight	LED - 30,000 hour life
Screen Update Rate	User configurable within the scan time (perceived as instantaneous in many cases)

Connectivity	
Serial Ports	1 RS-232 or 1 RS-485 on first modular jack (MJ1) 1 RS-232 or 1 RS-485 on second modular jack (MJ2)
USB mini-B	USB 2.0 (480MHz) Programming & Data Access
CAN	Remote I/O, Peer-to-Peer Comms, i3 Configurator
Ethernet	10/100MB (Auto-MDX), Modbus TCP, HTTP, FTP, SMTP, i3 Configurator, Ethernet IP, ASCII TCP
Remote I/O	IOS, Smart I/O, iSmart
Removable Memory	MicroSD™ (support for 32GB max) Application updates, Datalogging, more

Input / Output Specifications											
Model	DC In	DC Out	Relays	HS In	HS Out	mA/V In	mA/V RTD/TC	mA/V Out	High Speed Counters		
10D03	12		6	4		4			Number of Counters	4	
10B04	12	12		4	2	2			Maximum Frequency	500kHz each	
20B05	24	16		4	2	2			Accumulator Size	32-bits each	
13C14	12	12		4	2		2	2	Modes Supported		
10E24	12	12		4	2		6*	4*	Totalizer	Quadrature	
There are 4 high-speed inputs of the total DC inputs. There are 2 high-speed outputs of the total DC outputs. Model 10D03, 10B04, 20B05 feature 12-bit Analogue I/O. Model 13C14 features 14/16-bit Analogue I/O. High-speed outputs can be used for PWM and Pulse Train Outputs, currently limited to <10kHz and <65kHz for the 10E24 model. Model 10E14 features a 14/17 bit Analogue I/O.										Pulse Measurement	Frequency Measurement
										2 Position Controlled Outputs 1 ON/OFF Setpoint per Output	

## Dimensions & Panel Cutout

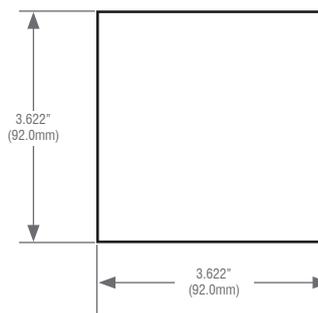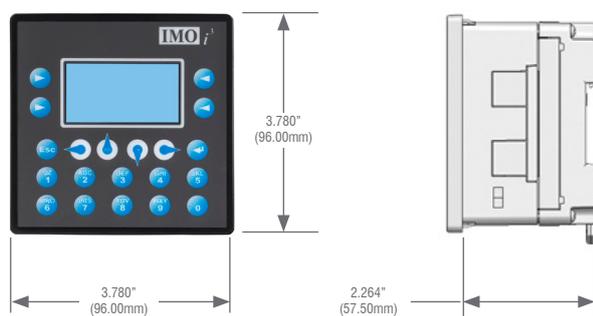


CUTOUT TOLERANCE TO MEET NEMA STANDARDS IS ±0.005" (0.1mm) Max. Panel Thickness is 5mm

NOTE: Depth including modem = 2.559" (65.0mm)


# i<sup>3</sup>AX Intelligent Control Station

## Ports & Connectors



### DC Input / Frame

Torque rating: 4.5-7 Lb-in (0.50-0.78Nm)  
 DC- is internally connected to I/O V-, but is isolated from CAN V-  
 A Class 2 power supply must be used




### CAN

Mounting screw torque rating: 4.5 Lb-in (0.50Nm)  
 SHLD and V+ pins are not internally connected to i<sup>3</sup>A


Primary Power Port Pins		
Pin	Signal	Signal Description
1	Ground	Frame Ground
2	DC-	Input Power Supply Ground
3	DC+	Input Power Supply Voltage

Primary Power Port Pins			
Pin	Signal	Description	Direction
1	V-	CAN Ground - Black	-
2	CN L	CAN Data Low - Blue	IN / OUT
3	SHLD	Shield Ground - None	-
4	CN H	CAN Data High - White	IN / OUT
5	V+ (NC)	No Connect - Red	-



### MJ1 Independent Serial Ports

Two multiplexed serial ports on one modular jack (8posn)




### MJ2 Serial Port

Two multiplexed serial ports on one modular jack (8posn)

PIN	MJ1 PINS	
	Signal	Direction
8	TXD RS-232	OUT
7	RXD RS-232	IN
6	0 V	Ground
5	+5V@60mA	OUT
4	RTS RS-232	OUT
3	CTS RS-232	IN
2	RX- / TX- RS-485	IN / OUT
1	RX+ / TX+ RS-485	IN / OUT

PIN	MJ2 PINS	
	Signal	Direction
8	TXD RS-232	OUT
7	RXD RS-232	IN
6	0 V	Ground
5	+5V@60mA	OUT
4	TX- RS-485	OUT
3	TX+ RS-485	OUT
2	RX- (RX- / TX-*) RS-485	IN or IN/OUT
1	RX+ (RX+ / TX+*) RS-485	IN or IN/OUT

\* In half duplex mode



### DIP Switches

Switch	Name	Function	Default
1	RS-485 Termination (MJ1)	ON = Terminated	OFF
2	RS-485 Termination (MJ2)	ON = Terminated	OFF
3	Factory Use	Always Off	OFF

### Built-in I/O

I/O is mapped into i<sup>3</sup> Register space, in three separate areas – Digital/Analogue I/O, High-Speed Counter I/O, and High-Speed Output I/O. Digital/Analogue I/O location is fixed starting at 1, but the High-Speed Counter and High-Speed Output references may be mapped to any open register location. For more details on using the High-Speed Counter and High-Speed Outputs, see the i<sup>3</sup>AX User's Manual.

Fixed Address	Digital/Analog I/O Function	i <sup>3</sup> AX Model					
		10A01	10D03	10B04	20B05	13C14	10E24
%I1	Digital Inputs	1-12	1-12	1-12	1-24	1-12	1-12
	Reserved	13-32	13-32	13-31	25-31	13-31	13-31
	ESCP Alarm	n/a	n/a	32	32	32	32
%Q1	Digital Outputs	1-6	1-6	1-12	1-16	1-12	1-12
	Reserved	7-24	7-24	13-24	17-24	13-24	13-24
%AI1	Analogue Inputs	1	1-4	1-2	1-2	1-2	1-4:33-38
	Reserved	2-12	5-12	3-12	3-12	3-12	n/a
%AQ1	Reserved	n/a	n/a	1-8	1-8	1-8	1-8
	Analogue Outputs	n/a	n/a	n/a	n/a	9-10	9-12

Reserved areas maintain backward compatibility with other i<sup>3</sup> Controller models

Default Address*	High Speed Counter Function	i <sup>3</sup> AX Models
%I1601	Status Bits	1-8
%Q1601	Command Bits	1-32
%AI0401	Accumulator 1&2	1-8
%AQ0401	Preload & Match Values	1-12

\*Starting Address locations for %I, %Q, %AI & %AQ may be re-mapped by user

Default Address*	High Speed Output Function	i <sup>3</sup> AX Models
%I1617	Status Bits	1-8
%Q**	Command Bits	1-32
n/a	n/a	n/a
%AQ0421	PWM or Pulse Train Parameters	1-20

\*Starting Address locations for %I & %AQ may be re-mapped by user  
 \*\*Q1-Q2 are part of the Fixed I/O Map. In High Speed Output mode they can be used to initiate a Stepper/PTO Move

# i<sup>3</sup> AX Intelligent Control Station


## 13C14 I/O Board Specifications

Digital DC Inputs		Digital DC Outputs	
Inputs per Module	12 including 4 configurable HSC inputs	Outputs per Module	12 including 2 configurable PWM outputs
Commons per Module	1	Commons per Module	6
Input Voltage Range	10-30 VDC	Output Type	Sourcing / 10 K Pull-Down
Absolute Max. Voltage	35 VDC Max	Absolute Max. Voltage	28 VDC Max
Input Impedance	10 kΩ	Output Protection	Short Circuit
Input Current	Positive Logic 0.8mA Negative Logic -1.6mA	Max. Output Current per Point	0.5A
Upper Threshold	0.3mA	Max. Total Current	4 A Continuous
Lower Threshold	8 VDC	Max. Output Supply Voltage	30 VDC
Max. Upper Threshold	3 VDC	Min. Output Supply Voltage	10 VDC
Max. Lower Threshold	1 ms	Max. Voltage Drop at Rated Current	0.25V
OFF to ON Response	1 ms	Max. Inrush Current	650 mA per channel
ON to OFF Response	1 ms	Min. Load	None
HSC Max. Switching Rate	500kHz	OFF to ON Response	1 ms
		ON to OFF Response	1 ms
		Output Characteristics	Current Sourcing (Positive Logic)
Analogue Inputs, High Resolution			
Number of Channels	2	Thermocouple	Temperature Range
Input Ranges (Selectable)	0 - 10 VDC, 0 – 20 mA, 4 – 20 mA, 100mV PT100 RTD, and J, K, N, T, E, R, S, B Thermocouple	B / R / S E T J K / N	2912°F to 32.0°F (1600°C to 0°C) 1652°F to -328°F (900°C to -200°C) 752.0°F to -400°F (400°C to -240°C) 1382.0°F to -346.0°F (750°C to -210°C) 2498.0°F to -400°F (1370°C to -240°C)
Nominal Resolution	10V, 20mA, 100mV: 14 Bits RTD, Thermocouple: 16 Bits	Thermocouple Common Mode Range	±10V
Converter Type	Delta Sigma	Max. Thermocouple Error	±0.2% (±0.3% below -100°C)
Input Impedance (Clamped @ -0.5 VDC to 12 VDC)	Current Mode: 100 Ω, 35mA Max. Continuous Voltage Mode: 500 kΩ, 35mA Max. Continuous	Max. Error at 25°C (*excluding zero)	4-20 mA ±0.10% *0-20 mA ±0.10% *0-10 VDC ±0.10% RTD (PT100) ±1.0°C 0-100 mV ±0.05%
AI Full Scale	10 V, 20 mA, 100 mV: 32,000 counts full scale. RTD / T/C: 20 counts / °C	Conversion Speed, Both Channels Converted	10V, 20mA, 100mV: 30 Times/Second RTD, Thermocouple: 7.5 Times/Second
Max. Over-Current	35mA	Conversion Time per Channel	10V, 20mA, 100mV: 16.7mS RTD, Thermocouple: 66.7mS
Open Thermocouple Detect Current	50mA	RTD Excitation Current	250 μA
Analogue Outputs			
Number of Channels	4	Minimum Current Load	500Ω
Output Ranges	0-10VDC, 0-20mA, 4-20mA	Galvanic Isolation	None
Nominal Resolution	12 Bits	Conversion Speed	Min. all channels once per scan
Response Time	One update per ladder scan		
Max. Error at 25°C (excluding zero)	0-20mA 0.1% of FS 0-10V 0.1% of FS	Additional Error for temperatures other than 25°C	20mA 0.0126%/°C

# i<sup>3</sup> AX Intelligent Control Station




J1 (Orange)	Name
I1	IN1
I2	IN2
I3	IN3
I4	IN4
I5	IN5
I6	IN6
I7	IN7
I8	IN8
H1	HSC1 / IN9
H2	HSC2 / IN10
H3	HSC3 / IN11
H4	HSC4 / IN12
NC	No Connect
NC	No Connect
0V	Common



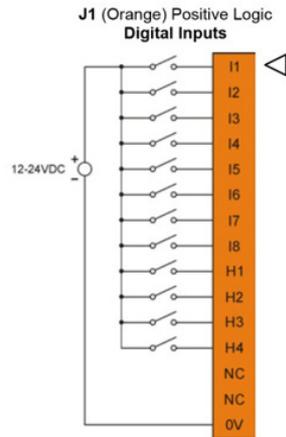


J2 (Black)	Name
0V	Common
V+	Output Power
NC	No Connect
Q12	OUT12
Q11	OUT11
Q10	OUT10
Q9	OUT9
Q8	OUT8
Q7	OUT7
Q6	OUT6
Q5	OUT5
Q4	OUT4
Q3	OUT3
Q2	OUT2 / PWM2
Q1	OUT1 / PWM1

J2 (Black) Positive Logic Digital Outputs



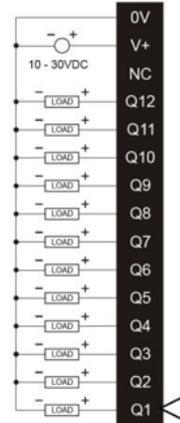


J3 (Orange)	Name
T1+	TC (1+) or RTD (1+) or 100mV (1+)
T1-	TC (1-) or RTD (1-) or 100mV (1-)
T2+	TC (2+) or RTD (2+) or 100mV (2+)
T2-	TC (2-) or RTD (2-) or 100mV (2-)
AQ1	10V or 20mA Out (1)
AQ2	10V or 20mA Out (2)
0V	Common
MA1	0-20mA In (1)
V1	0-10V In (1)
0V	Common
MA2	0-20mA In (2)
V2	0-10V In (2)
0V	Common

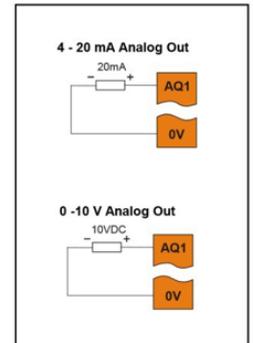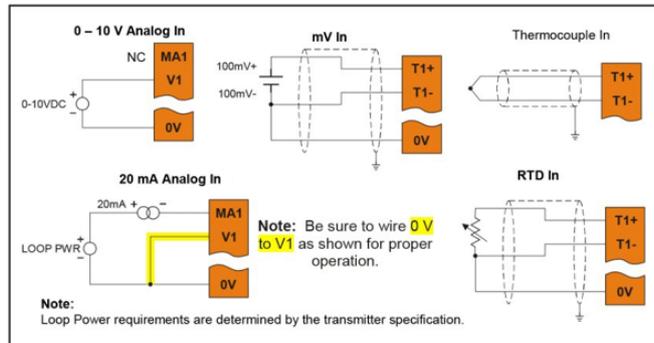


Location of I/O jumpers (JP1-JP4) and wiring connectors (J1-J4) with back cover removed.

### Jumper Setting Details

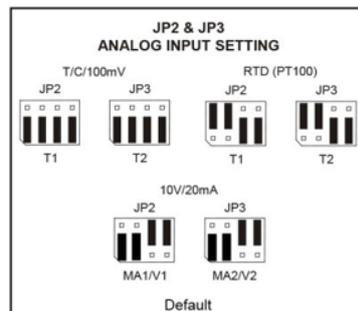

# i<sup>3</sup> AX Intelligent Control Station

## Example of Universal Input Wiring Schematic

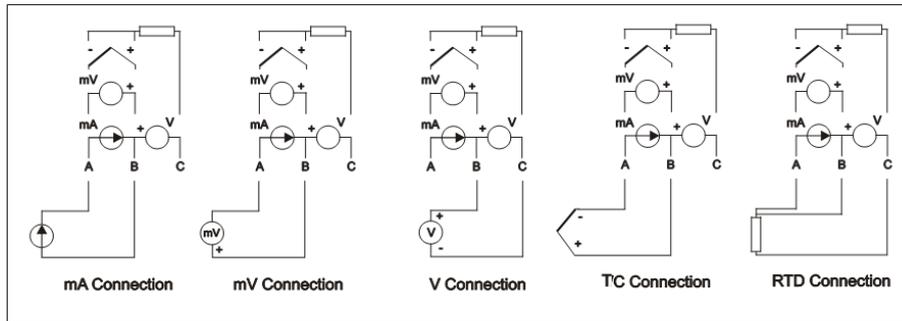

### Configuration

The data registers as follows:-

Digital Inputs	Digital Outputs	Analogue Inputs	Analogue Outputs
%I1-12	%Q1-12	%AI1-4, %AI33-38	%AQ9-12

Note: The first four Analogue inputs are mapped to both %AI1-4 and %AI33-36, analogue input channels 5 & 6 are mapped to %AI37 and %AI38 respectively only.

### Data Values

The analogue inputs return data types as follows:-

Input Mode	Data Format	Comment
0-20mA, 4-20mA	0-32000	
0-10V, 0-60mV	0-32000	
TC, RTD	Temperature in °C or °F to 1 decimal place xxx.y	°C or °F may be selected in the I/O config section. The value is an integer, the user should divide by 10.

### Status Register

Register	Descriptions							
%R1	Bit-wise status register enable – R1.1 – R1.9 enable for registers R2 to R9							
%R2	Firmware version							
%R3	Watchdog count – cleared on power-up.							
%R4	Status bits -				16...4	3	2	1
					Reserved	Normal	Config	Calibration
%R5	Scan rate of the 10E24 board (average) in units of 100µS.							
%R6	Scan rate of the 10E24 board (max) in units of 100µS.							
%R7	Channel Status Channel 2				Channel 1			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R8	Channel Status Channel 4				Channel 3			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R9	Channel Status Channel 6				Channel 5			
	8	7	6	5	4	3	2	1
	Open RTD	Out of Limits	Shorted RTD	Open TC	Open RTD	Out of Limits	Shorted RTD	Open TC
%R10-14	Reserved							

Note: For the purposes of the example, the block is shown starting at %R1, but it can be set to anywhere in the %R memory map.

# i<sup>3</sup> AX Intelligent Control Station

## Safety

**WARNING:** Battery may explode if mistreated. Do not recharge, disassemble or dispose of in fire.

**WARNING: EXPLOSION HAZARD - BATTERIES MUST ONLY BE CHANGED IN AN AREA KNOWN TO BE NON-HAZARDOUS**

This equipment is suitable for use in Class 1, Division 2, Groups A, B, C and D or Non-hazardous locations only.

**FOR U.S. & CANADA ONLY**

Power input and output (I/O) wiring must be in accordance with Class 1, Division 2 wiring methods of the National Electric Code, NFPA70 for installations in the U.S. or as specified in Section 18-1J2 of the Canadian Electric Code for installations within Canada and in accordance with the authority having jurisdiction.

**WARNING: EXPLOSION HAZARD - Do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.**

**WARNING: EXPLOSION HAZARD - Substitution of components may impair suitability for Class 1, Division 2.**

Digital outputs shall be supplied from the same source as the i3 Controller.

**WARNING:** Only qualified electrical personnel familiar with the construction and operation of this equipment and the hazards involved should install, adjust, operate, or service this equipment. Read and understand this manual and other applicable manuals in their entirety before proceeding. Failure to observe this precaution could result in severe bodily injury or loss of life.

**WARNING:** To avoid the risk of electric shock or burns, always connects the earth ground before making any other connections.

**WARNING:** To reduce the risk of fire, electrical shock, or physical injury it is strongly recommended to fuse all Power Sources connected to the i3 controller. Be sure to locate fuses as close to the source as possible.

**WARNING:** Replace fuse with the same type and rating to provide protection against risk of fire and shock hazards.

**WARNING:** In the event of repeated failure, do not replace the fuse again as a repeated failure indicates a defective condition that will not clear by replacing the fuse.

Jumpers on connector JP1 and others shall not be removed or replaced while the circuit is live unless the area is known to be free of ignitable concentrations of flammable gases or vapours.

## Common Cause of Analogue Input Transorb Failure

If a 4-20mA circuit is initially wired with loop power, but without a load, the analogue Input could see 24VDC. This is higher than the rating of the transorb. This can be solved by NOT connecting loop power prior to load connection, or by installing a low-cost PTC in series between the load and analogue input.

