

NEW



ND40

- POWER NETWORK ANALYZER / RECORDER


- Measurement and recording of over 500 electric energy quality parameters acc. to EN 50160, EN 61000-4-30, EN 61000-4-7 standards.
- Measuring class A - for 3 second aggregation. 10 minute and 2 hour aggregation - class S.
- Operation in 3 or 4-wire, 3-phase, balanced or unbalanced power networks.
- Analysis of current and voltage harmonics up to the 51st for class I (acc. to EN 61000-4-7).
- Configurable archives of actual values and event recording.
- Data archiving on an SD card - memory up to 32 GB.
- E-mail messages in case of alarm occurs,
- Web Server, FTP Server.
- Interfaces: RS-485 Modbus Slave, Ethernet 100 Base-T (Modbus TCP Server), USB Device & Host.
- Colour touch screen: LCD TFT 5.6", 640 x 480 pixels.
- IP65 protection grade from the frontal side.
- Synchronization of RTC clock with the NTP time server.

**CLASS
A***



* for selected parameters - details in the technical data

EXAMPLE OF APPLICATION

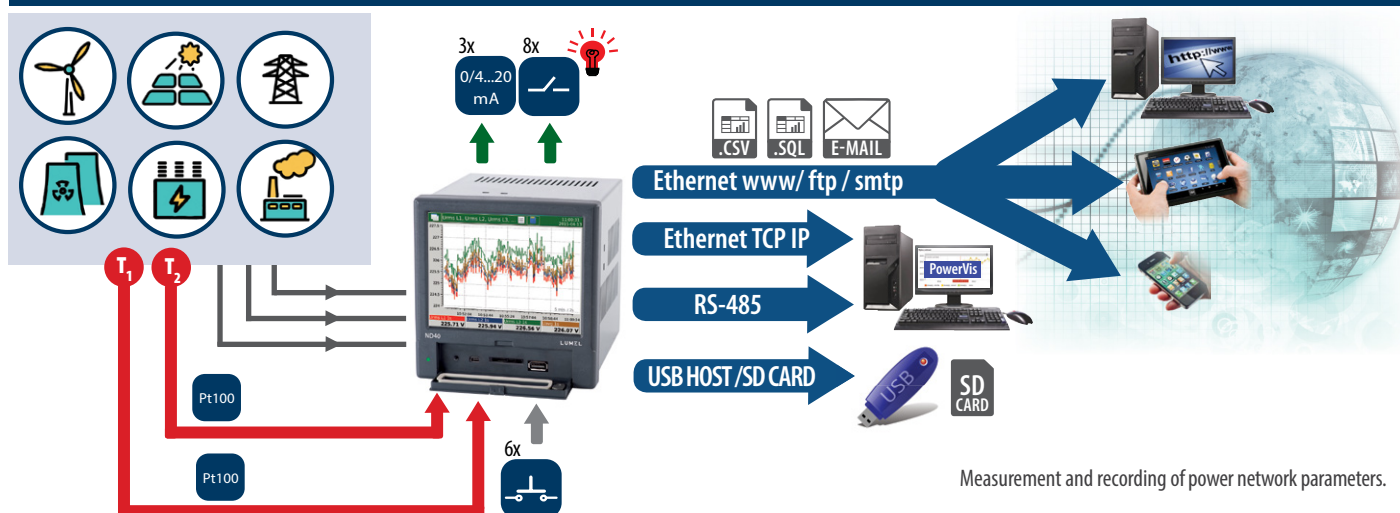

Measurement and recording of power network parameters.

MEASUREMENT AND VISUALIZATION OF POWER NETWORK PARAMETERS


Aggregated values for 3 seconds, 10 minutes and two hours:

- phase voltages $U_1, U_2, U_3, U_{123\text{ avg}}$
- phase current $I_1, I_2, I_3, I_{123\text{ avg}}$
- active phase powers $P_1, P_2, P_3, \Sigma P_{123}, P_{123\text{ avg}}$
- reactive phase powers $Q_1, Q_2, Q_3, \Sigma Q_{123}, Q_{123\text{ avg}}$
- apparent phase powers $S_1, S_2, S_3, \Sigma S_{123}, S_{123\text{ avg}}$
- active power factors $PF_1, PF_2, PF_3, PF_{123\text{ avg}}$
- power factor distortion $dPF_1, dPF_2, dPF_3, dPF_{123\text{ avg}}$
- reactive/active power factors $tg\varphi_1, tg\varphi_2, tg\varphi_3, tg\varphi_{123\text{ avg}}$
- phase-to-phase voltages $U_{12}, U_{31}, U_{23}, U_{123\text{ avg}}$
- current in neutral wire I_n
- the angle between the voltage and current $\varphi_1, \varphi_2, \varphi_3, \varphi_1, \varphi_{123\text{ avg}}$ (degrees and radians)
- voltage phase-to-phase angle $\angle U_{12}, \angle U_{31}, \angle U_{23}, \angle U_{123\text{ avg}}$


Other parameters:

- frequency (aggregation for 1 and 10 seconds)
- temperature/ resistance values (two channels)
- Demand values: P, Q, S, U, I (15-minute, 30-minute or 1 hour).
- energy: active imported/exported, reactive imported/exported and apparent. All energies are calculated for each phase and 3-phase parameters.
- factors: THD, THDS, THDG, PWHD. Calculated for currents and voltages of each phase and 3-phase parameters.
- harmonics from 1 up to 51st for each phase of currents and voltages
- the half wave voltage of each phase
- recording of dips, swells and overvoltages
- storage of minimum and maximum of measured values.


FEATURES




INPUTS



OUTPUTS



GALVANIC ISOLATION



TECHNICAL DATA

INPUTS

Input type	Measuring range	Parameters	Basic error
Voltage input	230/400 V 57,7/100V	0.05...1.5 Un	± 0.1%
Current input	1A or 5A	0.005...1.5 In	± 0.1%
Logic input	6 logic inputs: 0/5...24 V d.c.	switching frequency up to 50 Hz	
Input for temperature measurement	Pt100: -200...850°C, Pt1000: -200...850°C, resistance: 0...5000 Ω		± 0.2%

OUTPUTS

Output type	Properties
Analog output	3 programmable current outputs 0/4...20 mA, load resistance < 500 Ω
Relay output	8 programmable electromagnetic relays, voltageless NO contacts, load capacity 250 V a.c./1 A a.c.

DIGITAL INTERFACES

Interface type	Properties
RS-485	2 interfaces: MODBUS Slave and Master, baud rate 300...115200 bit/s, transmission mode ASCII/RTU
USB	2 interfaces: Device & Host, USB v.2.0
Ethernet	100 Base-T, RJ45 socket, Modbus TCP Server

RATED OPERATING CONDITIONS

Supply voltage	85 V...240 V a.c., 40...400Hz 90 V...320 V d.c.	power consumption: 15 VA, 35 VA (when loading)
Ambient temperature	work: 0 up to 50°C	storage: - 20...50°C
Relative humidity	< 75%	Condensation inadmissible
Reaction against	supply decays	Data and device state preservation
	supply recovery	Continuation of device work
Short term load (5s)	2 Un (max. 1000 V)	10 In
Casing protection grade	IP 65	
Safety requirements	Installation category III Pollution grade 2	EN 61010-1
Maximum phase-to-earth operating voltage	RS485, temperature/resistance input, USB: 50V measuring circuit, relays, supply: 300 V	EN 61010-1

MEASURING RANGES AND ADMISSIBLE BASIC CONVERSION ERRORS

Measuring quantity	Measurement method	Range	Basic error
Voltage U RMS	U RMS averaged values: 1 s class: B 3 s class: A 10 min class: S 2 hrs class: S	U RMS L-N (150% Un) Un = 230 V 23.0...46...345.0 V (Ku=1) ...480.0 kV (Ku≠1) Un = 57.7 V 5.7...11.5...70.0 V (Ku=1) U RMS L-L (150% Un): Un = 400 V 40.0...80...600.0 V (Ku=1) ...1020.0 kV (Ku≠1) Un = 100V 10.0...20...120.0 V (Ku=1)	class A acc. to EN 61000-4-30:2008 U RMS L-N (10% U _{din} - 150% U _{din}): ±0.1% U _{din} .
Current I RMS	I RMS averaged values: 1 s class: B 3 s class: A 10 min class: S 2 hrs class: S	I RMS (150% In): In = 1 A - 0.010...0.1...1.5 A (Ki=1) In = 5 A - 0.050...0.5...7.5 A (Ki=1) ...480.0 kA (Ki≠1)	I RMS (10% In - 150% In): ±0.1% of measurement
Frequency	Class S appointed from 10 or 12 cycles in 200 ms. Class A appointed from 100 or 120 cycles in 10 s.	42.5 up to 57.5 Hz for 50 Hz a.c. of supply 51.0 up to 69.0 Hz for 60 Hz a.c. of supply	Class S acc. to EN 61000-4-30:2008 ±0.050 Hz Class A acc. to EN 61000-4-30:2008 ±0.010 Hz

Active, reactive and apparent power	Active power: Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz) Reactive power: appointed from apparent and active power. Apparent power: appointed from value U RMS and I RMS.	Depends on voltage and actual ratio value.	acc. to EN 61557-12: Active power: $\pm 0.5\%$ Pn Reactive power: $\pm 1\%$ Qn Apparent power: $\pm 0.5\%$ Sn
Measuring quantity	Measurement method	Range	Basic error
Active imported/exported energy, reactive imported/exported energy, apparent energy	Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz). Separate measurement for exporten, imported active and reactive energy .	Depends on voltage and actual ratio value.	acc. to EN 61557-12: Active power: $\pm 0.5\%$ Reactive power: $\pm 1\%$ Apparent power: $\pm 2\%$
Active power factor, Power distortion factor	Active power factor : depends on U RMS, I RMS and active power. Power distortion factor depends on THD I.	-1,000 .. 0 .. 1,000	Power factor PF $\pm 0.01\%$ Power distortion factor PFdist $\pm 0.05\%$
Harmonics of voltages and current	acc. to EN 61000-4-7:2007, up to 51st harmonic Window: 10 cycles (for 50 Hz), 12 cycles (for 60 Hz). FFT: 4096 points	Voltage harmonics: 0.00 .. 100.00 % Current harmonics: 0.00 .. 100.00 %	Voltage harmonics – class II $\pm 5\%$ Urdg if Urdg > 1% $\pm 0.05\%$ Un if Urdg < 1% Current harmonics – class II $\pm 5\%$ Urdg if Urdg > 3% $\pm 0.5\%$ Un if Urdg < 3%
THD U, THD I, THDG U, THDG I, THDS U, THDS I, PWHU, PWHI	acc. to EN 61000-4-7:2007, up to 51st harmonic Window: 10 cycles (for 50 Hz), 12 cycles (for 60 Hz). FFT: 4096 points	THD U: 0.00 .. 100.00 % THD I: 0.00 .. 100.00 % THDG U: 0.00 .. 100.00 % THDG I: 0.00 .. 100.00 % THDS U: 0.00 .. 100.00 % THDS I: 0.00 .. 100.00 % PWHU: 0.00 .. 100.00 % PWHI: 0.00 .. 100.00 %	THD U: $\pm 5\%$ (50/60Hz) THD I: $\pm 5\%$ (50/60Hz) THDG U: $\pm 5\%$ (50/60Hz) THDG I: $\pm 5\%$ (50/60Hz) THDS U: $\pm 5\%$ (50/60Hz) THDS I: $\pm 5\%$ (50/60Hz) PWHU: $\pm 5\%$ (50/60Hz) PWHI: $\pm 5\%$ (50/60Hz)

where:

Ku - voltage transformer ratio
Ki - current transformer ratio
Udin - declared input voltage
Urdg, Irdg - measurement values
Un, In, Pn, Qn - nominal values

EXAMPLES OF MEASURING DATA PRESENTATION





Various forms of data display:

- digital display
- analog view,
- bargraphs,
- vector diagrams
- trends
- energy meter
- harmonics analysis
- energy meter.




Screen system log files.

Screens log alarms.

Control panel.

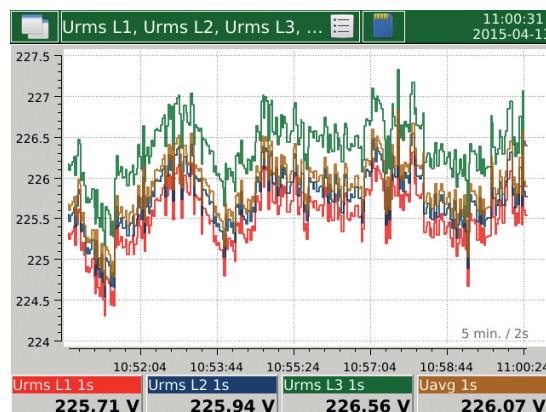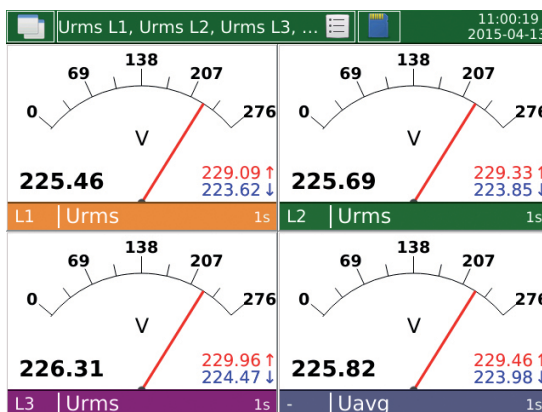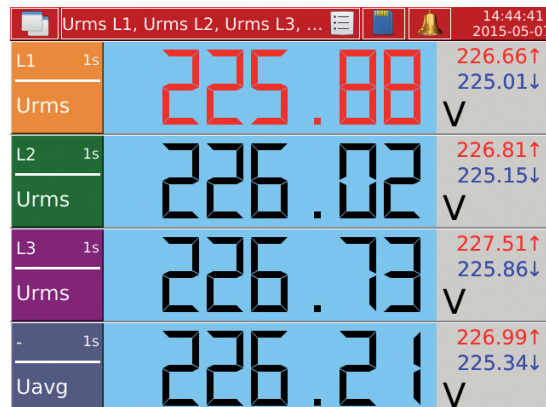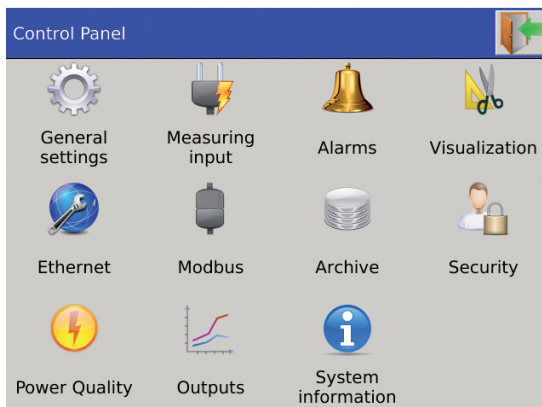

EXAMPLES OF MEASURING DATA PRESENTATION

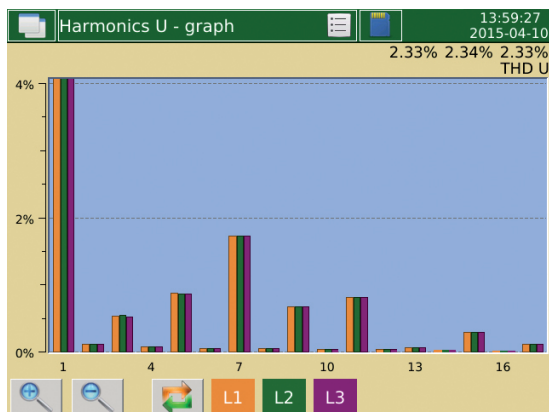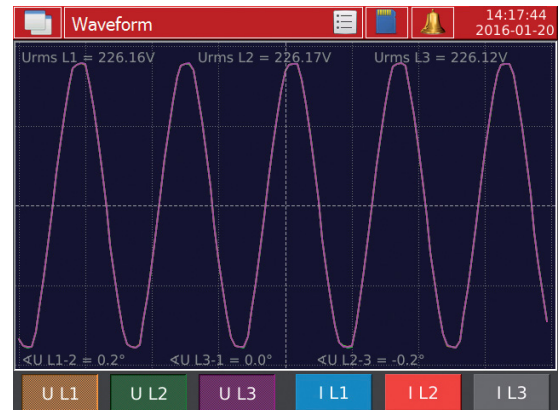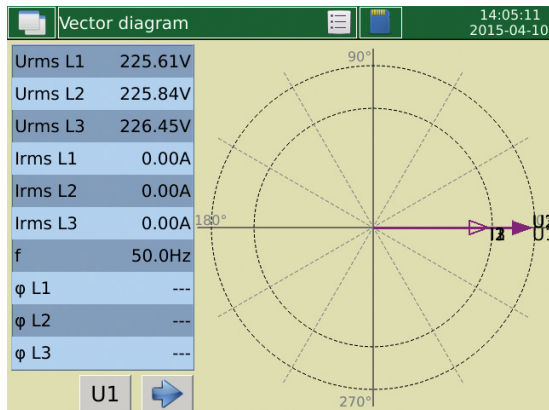

Harmonics U - table 14:00:48 2015-04-10

	L1 [%]	L2 [%]	L3 [%]
THD	2.34	2.35	2.34
THDG	2.34	2.35	2.34
THDS	0.00	0.00	0.00
PWHD	2.34	2.35	2.34
1	100.00	100.00	100.00
2	0.05	0.04	0.05
3	0.78	0.79	0.78
4	0.02	0.02	0.02
5	0.63	0.63	0.63
6	0.02	0.02	0.02
7	1.78	1.79	1.78
8	0.03	0.03	0.03
9	0.66	0.66	0.66
10	0.03	0.03	0.03

Energy 13:08:41 2015-04-15

	value	unit
Σ EnP+	00000000.0	kWh
L1	00000000.0	kWh
L2	00000000.0	kWh
L3	00000000.0	kWh
Σ EnP-	00000000.0	kWh
L1	00000000.0	kWh
L2	00000000.0	kWh
L3	00000000.0	kWh
Σ EnQ+	00000000.0	kVARh
L1	00000000.0	kVARh

Binary inputs 14:07:45 2015-10-20

	BI1 1		BI2 0
	BI3 0		BI4 0
	BI5 0		BI6 0

Alarm logs 14:18:23 2016-01-20

No	Date	Time	Description
43	2016-01-20	13:49:54	Alarm 2 - Wt. (Urms L2 200ms 224.811V) (> 210)
42	2016-01-20	13:49:54	Alarm 1 - Wt. (Urms L1 200ms 224.823V) (> 200)
41	2016-01-20	08:53:15	Alarm 1 - Wt. (Urms L1 200ms 240.477V) (> 200)
40	2016-01-19	16:00:19	Alarm 2 - Wt. (Urms L2 200ms 229.91V) (> 210)
39	2016-01-19	16:00:19	Alarm 1 - Wt. (Urms L1 200ms 229.898V) (> 200)
38	2016-01-19	15:36:32	Alarm 2 - Wt. (Urms L2 200ms 228.824V) (> 210)
37	2016-01-19	15:36:31	Alarm 1 - Wt. (Urms L1 200ms 228.798V) (> 200)

ETHERNET: WWW SERVER, FTP

LUMEL ND40 Meter

Measurement data	
Name	Value
Urms L1 1s	226.07V
Urms L2 1s	226.10V
Urms L3 1s	226.04V
Irms L1 1s	0.0603A
Irms L2 1s	0.0603A
Irms L3 1s	0.0603A
Pavg 1s	0.0071kW
ΣP 1s	0.0214kW
ΣQ 1s	-0.0349kvar
ΣS 1s	0.0409kVA
PFavg 1s	0.52
Umavg 1s	0.2533V

Alarms

Alarm 1 (Urms L1 200ms = 226.501V) (> 0.0)

Confirm

Files / ND40

Name	Modified	Size
Config_20160420_1026 ND40	2016-04-20 10:26:39	10.7 kB


System information

Device name	ND40
Device description	Power Analyzer
Serial number	16010002
System version	0.2.11
Used space on SD card	

Indeks ftp://10.0.1.84/ND40/

Name	Size	Data Modified
2015-07-15 08_49_41.ND40Arch	35 KB	2015-07-15 08:55:00
2015-07-15 08_55_40.ND40Arch	35 KB	2015-07-15 09:01:00
2015-07-15 09_01_40.ND40Arch	35 KB	2015-07-15 09:07:00
2015-07-15 09_07_35.ND40Arch	35 KB	2015-07-15 09:13:00
alarm.log.csv	2 KB	2015-07-15 09:21:00
audit.log.csv	2 KB	2015-07-15 09:22:00

DIMENSIONS AND ASSEMBLY

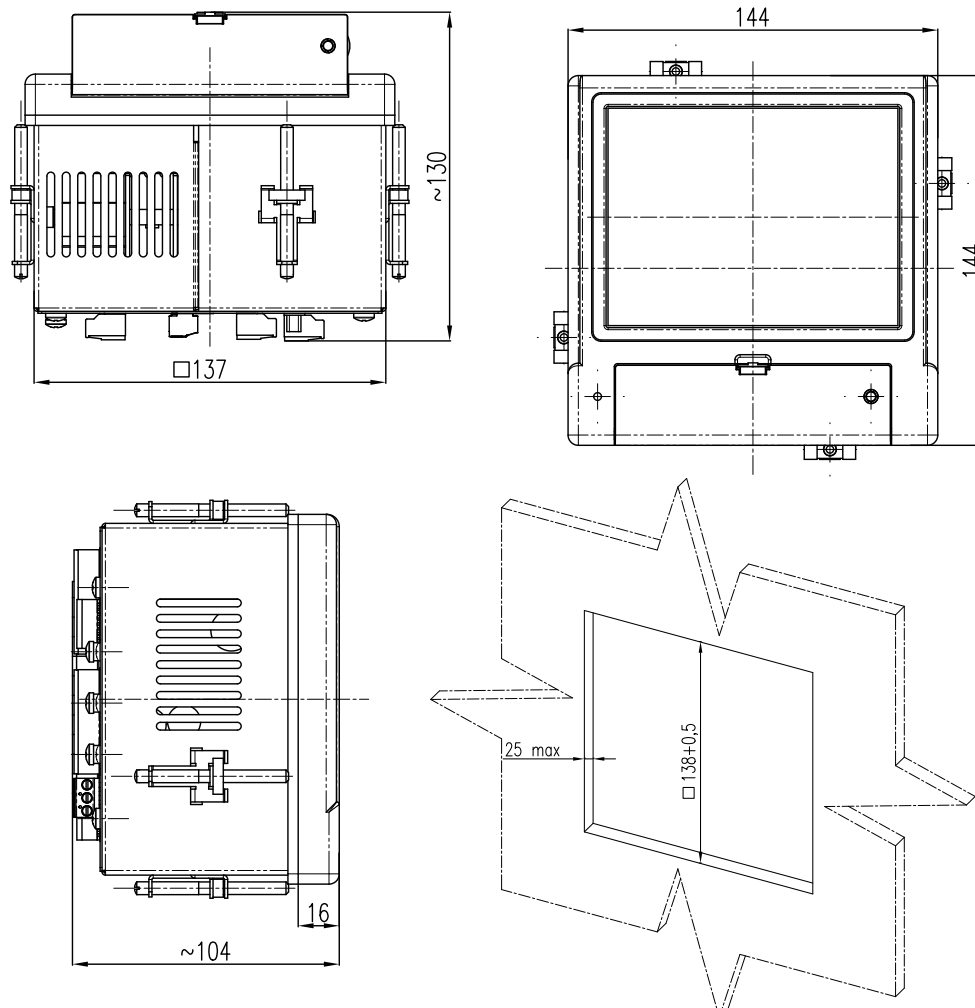

ORDERING CODE

Analyzer/recorder ND40 -	X	X	XX	X	X
Class:					
class S	0				
class A/S	1				
Inputs / outputs:					
whitout	0				
8 relay outputs	1				
6 logic inputs, 4 relay outputs	2				
6 logic inputs, 3 analog outputs	3				
Version:					
standard		00			
voltage input 3 x 57.7/ 100 V		01			
custom-made		XX			
Language:					
Polish			P		
English			E		
German			D		
Russian			R		
other*			X		
Acceptance tests:					
without additional quality requirements				0	
with an extra quality inspection certificate				1	
acc.to customer's request*				X	

Order example:

The code: **ND40 - 0 1 00 E 0** means:

ND40 - analyzer/ recorder ND40

0 - class S

1 - 8 relay outputs

00 - standard version

E - user's manual in English

0 - without additional quality requirements.

* only after agreeing with the manufacturer

SEE ALSO:



ND30 - power network meter with Ethernet and recording



RE92 - dual loop controller



P30U - universal transducer of temperature and standard signals



ND20 - power network meter



N43 - rail mounted 3-phase power network meter



P43 - 3-phase transducer of power network parameters



Current transformers from 5 A up to 6 kA



PowerVis - process visualization software



Free **eCON** software

For more information about Lumel products
please visit our website:

www.lumel.com.pl

Join us at Facebook!

